

NOTE:
VERTICAL SPACING JOINTS TO BE DETERMINED ON SITE UP TO A MAXIMUM OF 3m

250mm WIDE x 2mm THICK SIKAFLEX OR HYPALON BANDAGE TO MANUFACTURER'S SPECIFICATIONS



INSIDE TANK

TYPICAL HORIZONTAL (IN-WALL) CONSTRUCTION JOINT DETAIL
SCALE 1 : 10

150mm x 1.6mm THICK MILD STEEL STRIPS, HOT DIP GALVANISED

CHIP CONCRETE SURFACE, CLEAN OFF DUST, DIRT AND LOOSE CONCRETE DEPOSITS USING A WIRE BRUSH. APPLY RICH MIX SAND-CEMENT SLURRY (GRADE 35) BEFORE POURING SUBSEQUENT LIFT

OUTSIDE TANK


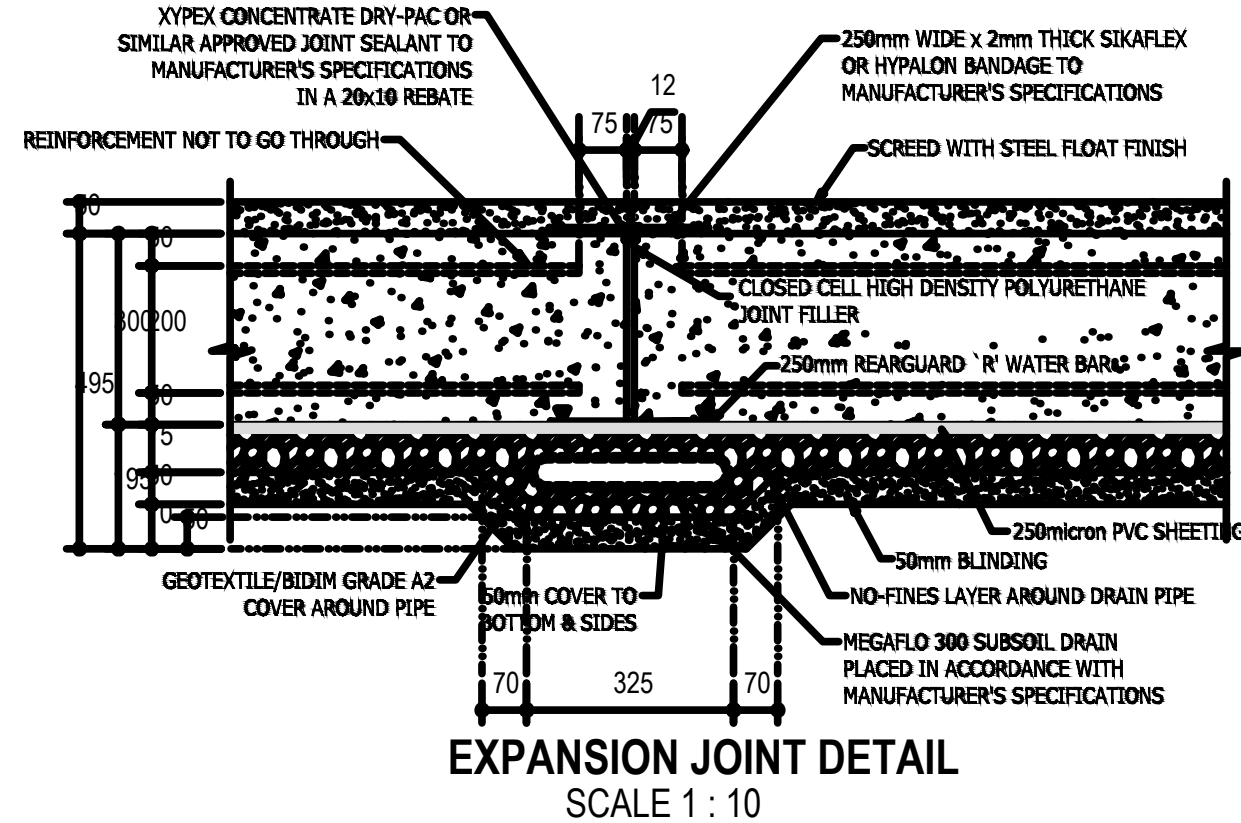
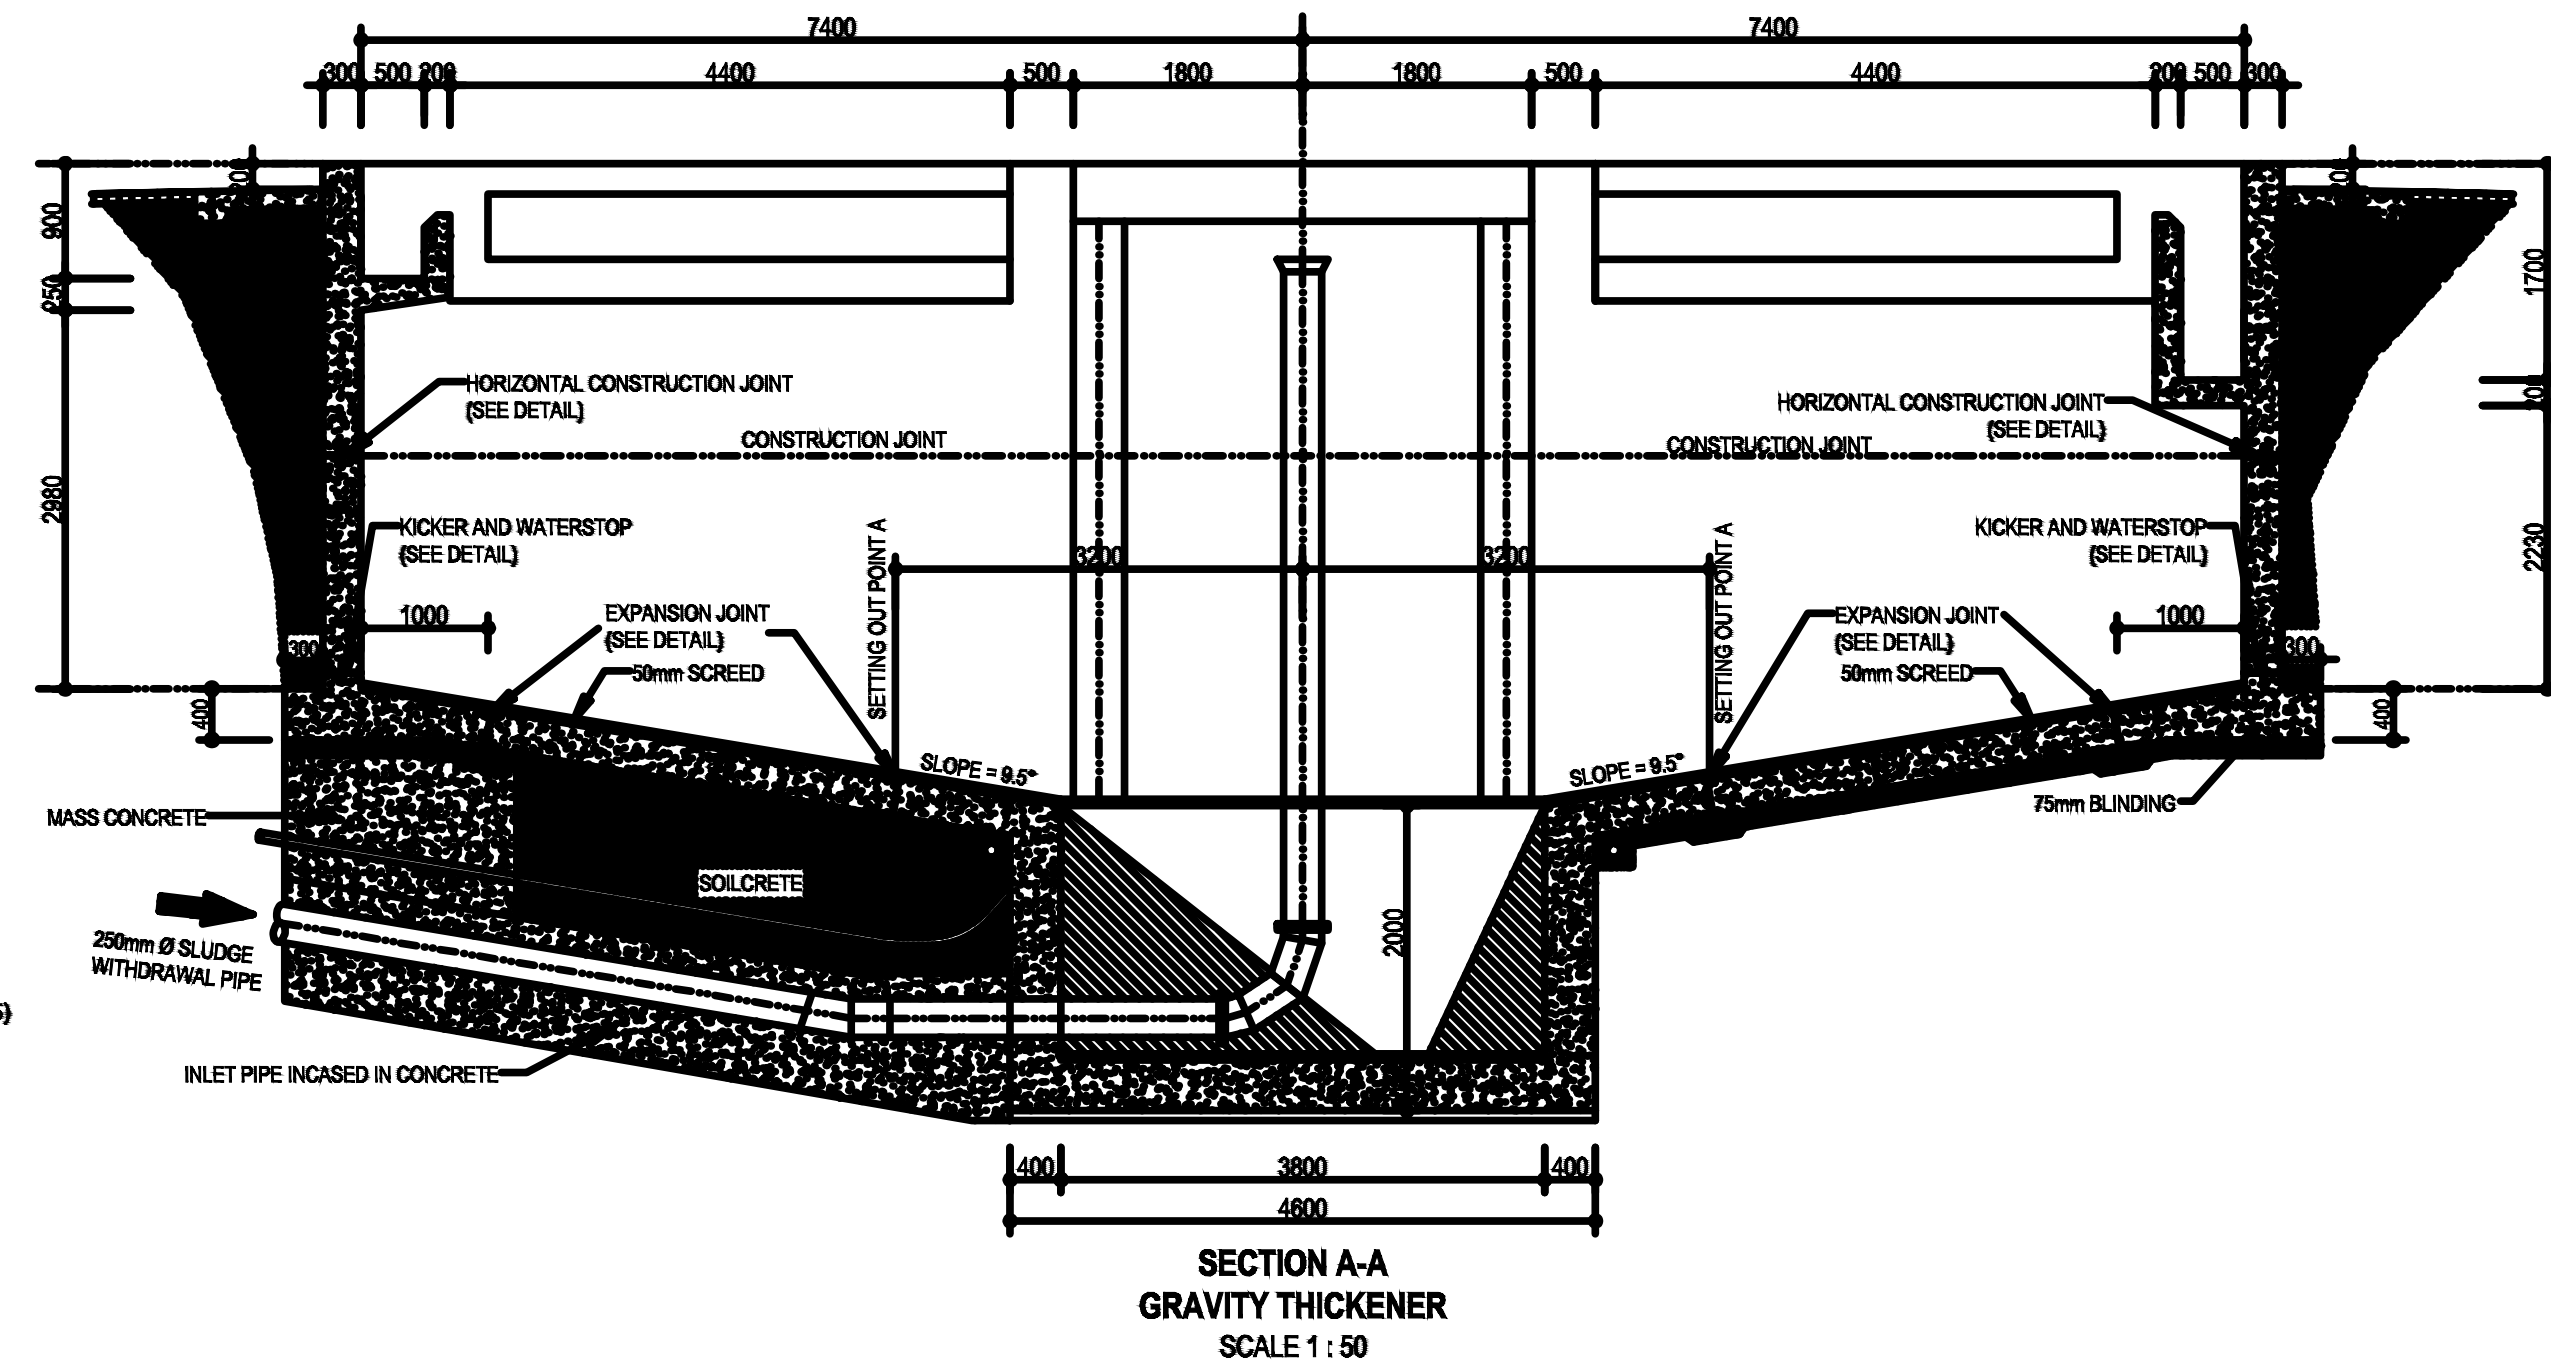


250mm WIDE x 2mm THICK SIKAFLEX OR HYPALON BANDAGE TO MANUFACTURER'S SPECIFICATIONS

150mm x 1.6mm THICK MILD STEEL STRIPS, HOT DIP GALVANISED


CHIP CONCRETE SURFACE, CLEAN OFF DUST, DIRT AND LOOSE CONCRETE DEPOSITS USING A WIRE BRUSH. APPLY RICH MIX SAND-CEMENT SLURRY (GRADE 35) BEFORE POURING SUBSEQUENT LIFT

TYPICAL DETAIL OF KICKER AND WATERSTOP
SCALE 1 : 10

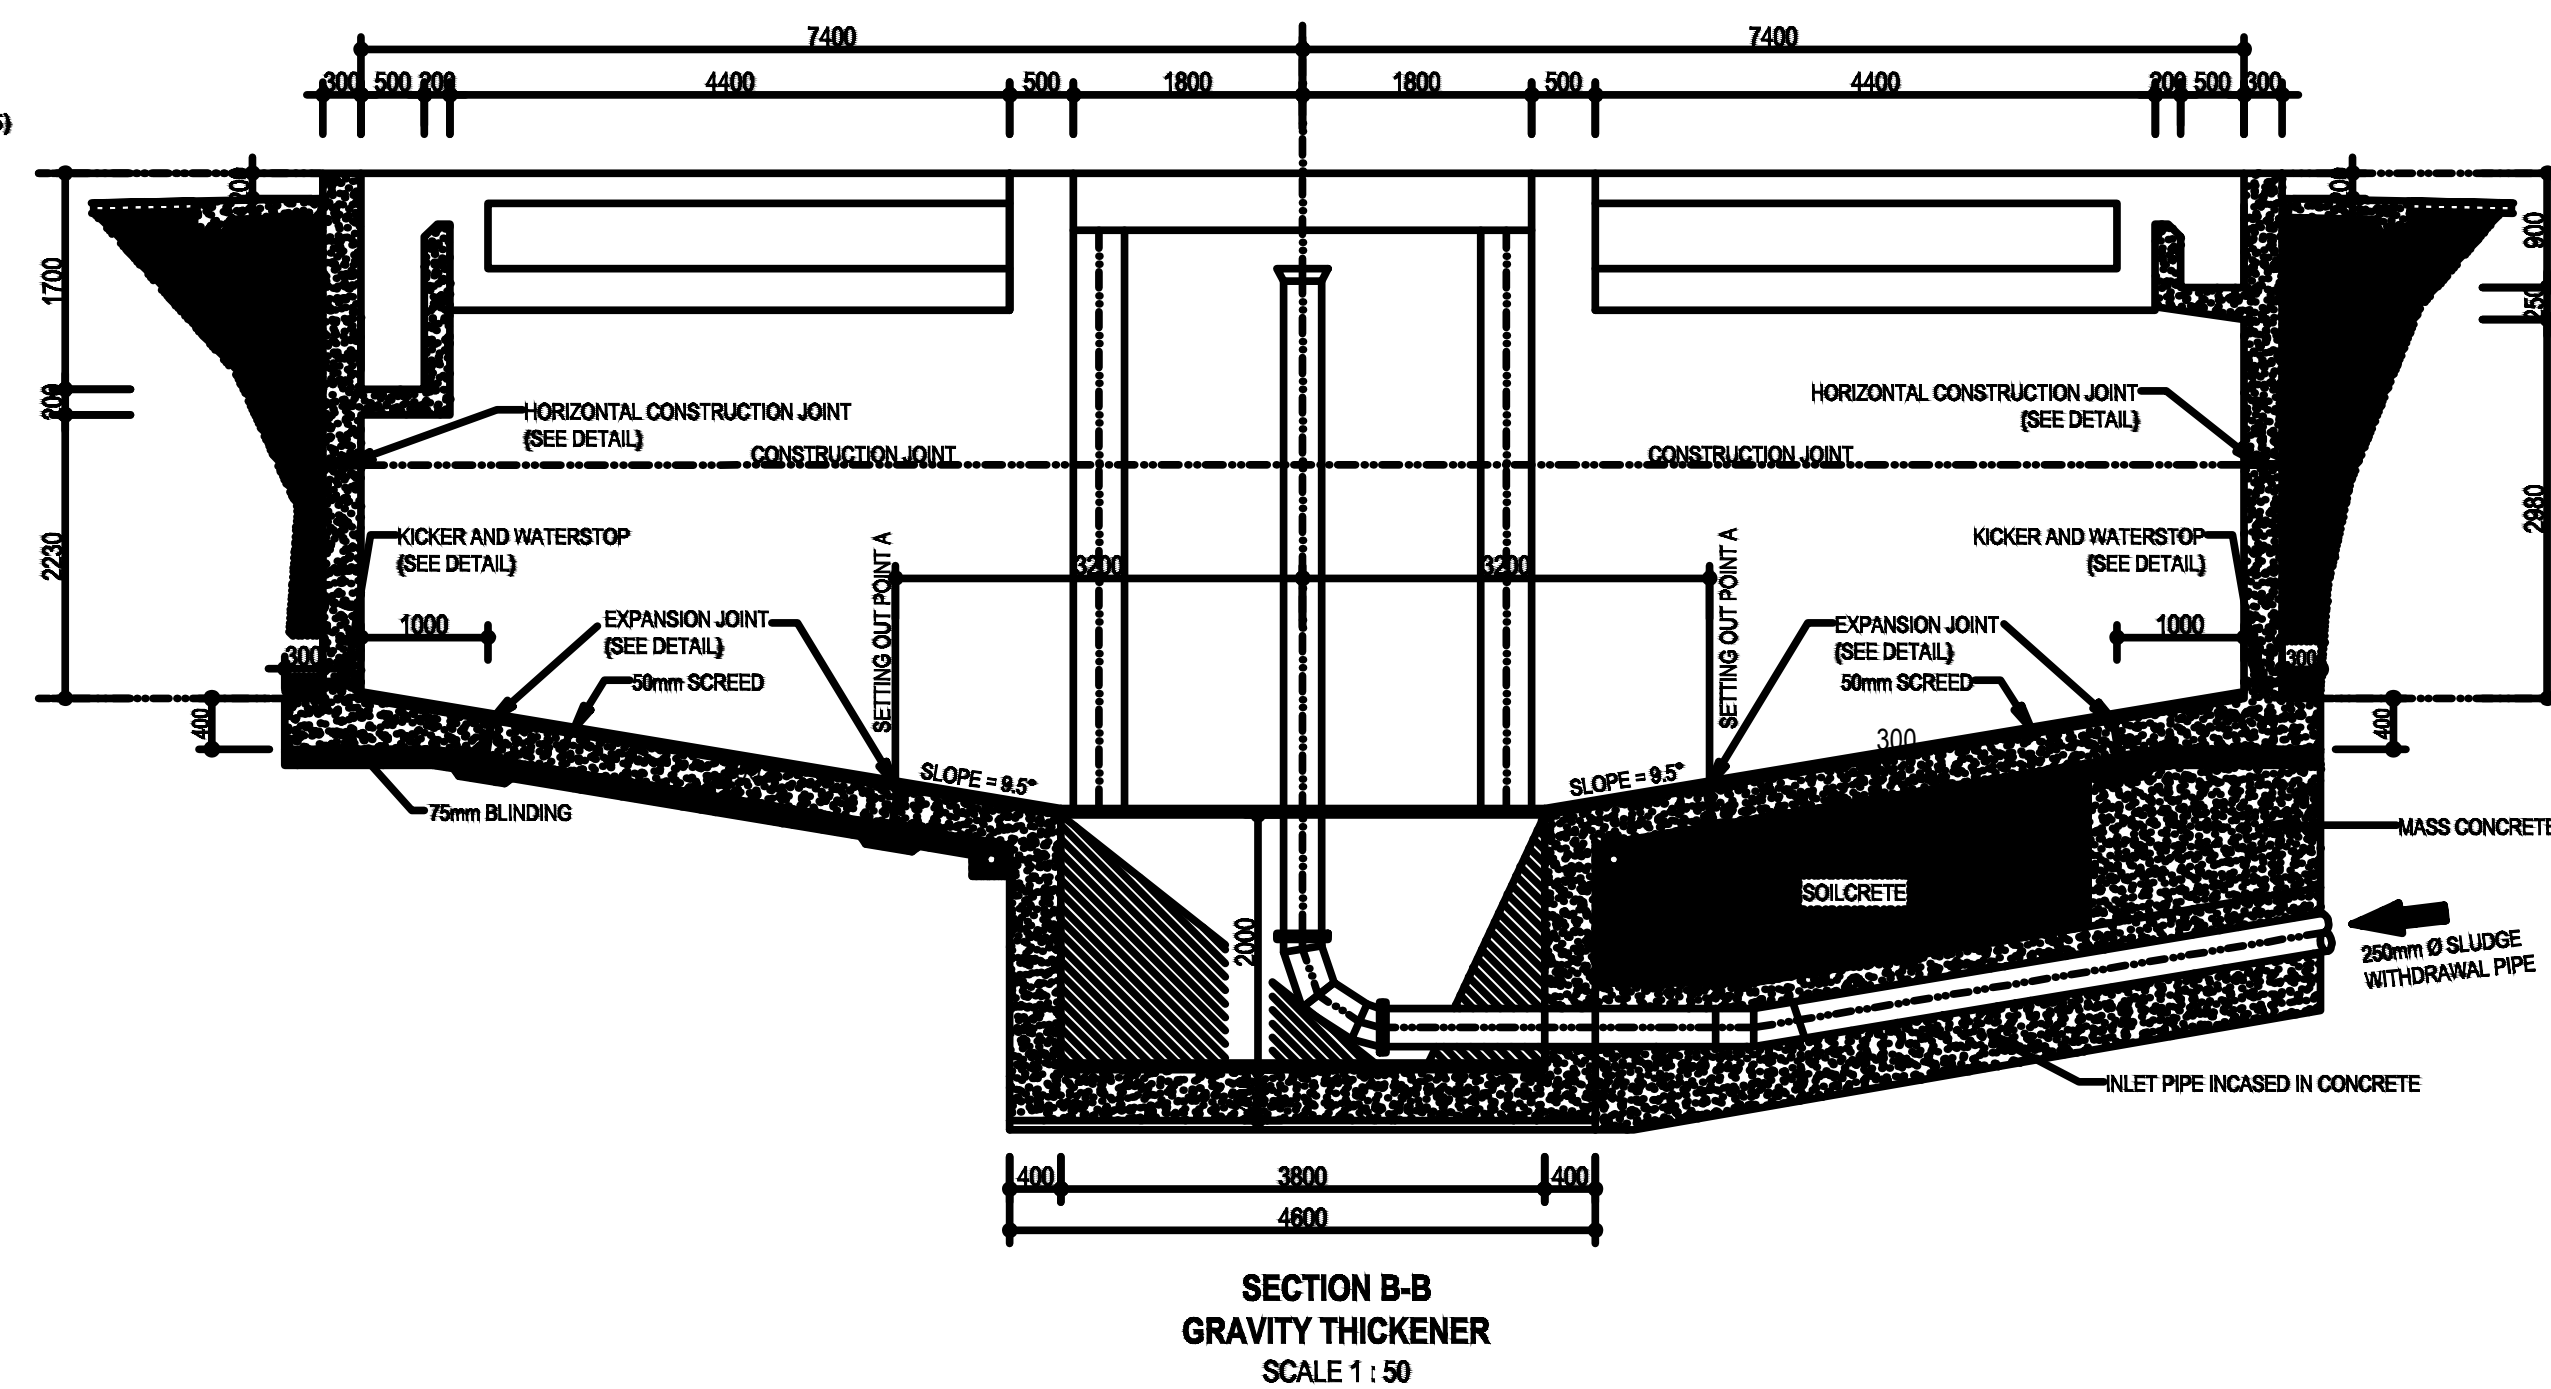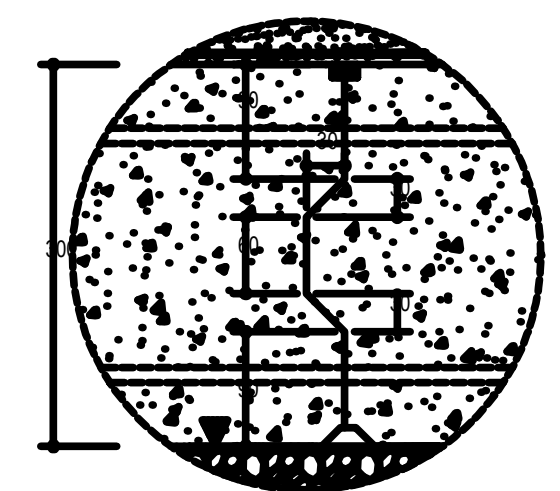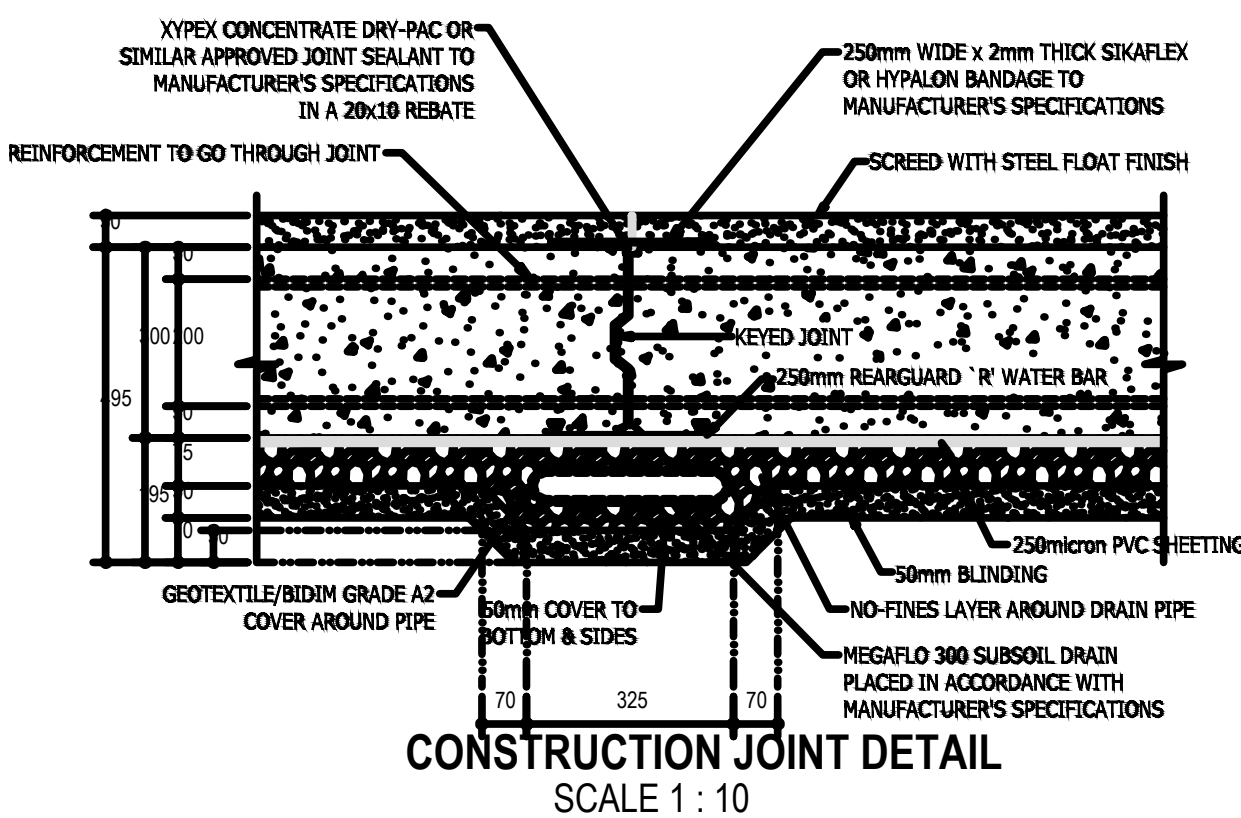

LEGEND:

No	AMENDMENTS	DATE
0	ISSUED FOR APPROVAL	30-09-2021

SURVEYED		
DRAWN	RM	30-09-2021
DESIGNED	LT	30-09-2021
CHECKED	LT	30-09-2021
APPROVED	 PR REGISTRATION NO. 201370235 DATE: 30-09-2021	

ENGINEER

Asande Projects
Consulting & Engineering

CLIENT



PROJECT TITLE
PAARL WASTE WATER TREATMENT PLANT UPGRADES

DRAWING TITLE
GRAVITY THICKNER LAYOUT AND DETAILS

SCALE	SHEET SET	SHEET SIZE
AS SHOWN	SHEET 1 OF 1 SHEETS	A1
DRAWING No.	PWWTP-STR-0070	REVISION

PRELIMINARY